

RP-6A Type Pressure Reducing Valve (for Air or Gases)

for **Factory Equipments** **Variety of Devices**, etc., General-purpose Pilot-operated Valve(Large capacity)

A companion to RP-6 Type especially designed for air and gases.
Refer to Page 20 for valve size selection chart.

FEATURES

- Piston guide and diaphragm allow stable control.
- Wide range of pressure and flow for a variety of applications.
- Easy pressure adjustment by manual handle with automatic lock mechanism.
- Compact design.

SPECIFICATIONS

Model name		RP-6A	
Code name		RP6A-B	RP6A-G
Applicable fluid		Air & gases	
Fluid temperature		5~80°C	
Applicable primary pressure		Max. 1.0 MPa	
Adjustable secondary pressure		0.03~0.8 MPa	
Maximum reducing rate		10:1	
Minimum pressure differential across the disc		0.07 MPa	
Lock up pressure		Max. 0.02 MPa	
Offset pressure	Size 15~80mm	Within 0.02 MPa (Adjustable secondary pressure 0.03~0.035 MPa) Within 0.03 MPa (Adjustable secondary pressure over 0.035~0.07 MPa) Within 0.05 MPa (Adjustable secondary pressure over 0.07~0.8 MPa)	
	Size 100~200mm	Within 0.05MPa	
Leakage allowance		Size 15~80mm: Nil (Confirm at pressure gauge), Size 100~200mm: Less than 0.01% of rated flow	
End connection		Flanged JIS 10KFF	
Materials	Body	Cast iron	
	Disc & seat	Disc (Brass with synthetic rubber)*, Seat (Stainless steel)	Disc (Stainless steel with synthetic rubber)*, Seat (Stainless steel)
	Piston & cylinder	Brass & Cast bronze	Stainless steel
Valve body pressure test		Hydraulic 1.5 MPa	
Installation		Upright installation on horizontal pipe	

* The valve disc of sizes 100~200mm are made of stainless steel (metal touch).


DIMENSIONS

(mm)


Size	L	G	H	d	Cv value	Mass(kg)
15(½")	140	62	155	¼"	1	7.5
20(¾")	140	62	155	¼"	2.5	7.5
25(1")	150	67	160	¼"	4	9
32(1¼")	180	73	182	⅜"	6.5	12
40(1½")	180	73	182	⅜"	9	12.5
50(2")	200	86	187	⅜"	16	15.5
65(2½")	230	94	202	⅜"	25	20.5
80(3")	260	110	221	⅜"	36	26.5
100(4")	320	139	285	⅜"	64	52
125(5")	380	187	320	⅜"	100	82
150(6")	420	206	368	⅜"	144	110
200(8")	540	255	425	⅜"	256	176

Flange code JIS 10KFF

CONSTRUCTION

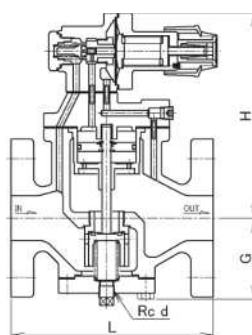

Size 15~80mm

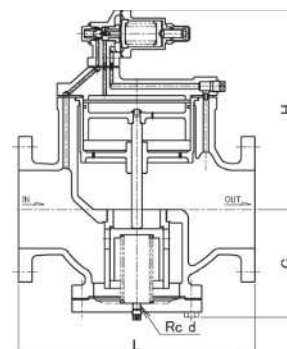

Size 100~200mm

REFERENCE

We also provide spacers for adjustment of face to face dimension. Such spacers are useful when replacing RP-1HA Type with RP-6A Type valve, such as in the case of modification of equipment. For more details, please contact our agent in your area.




DATA/RP-6A, 8A Type Pressure Reducing Valve (for Air or Gases)

NOMINAL DIAMETER SELECTION CHART (for Air or Gases)

1

PRESSURE REDUCING VALVES (FOR AIR OR GASES)

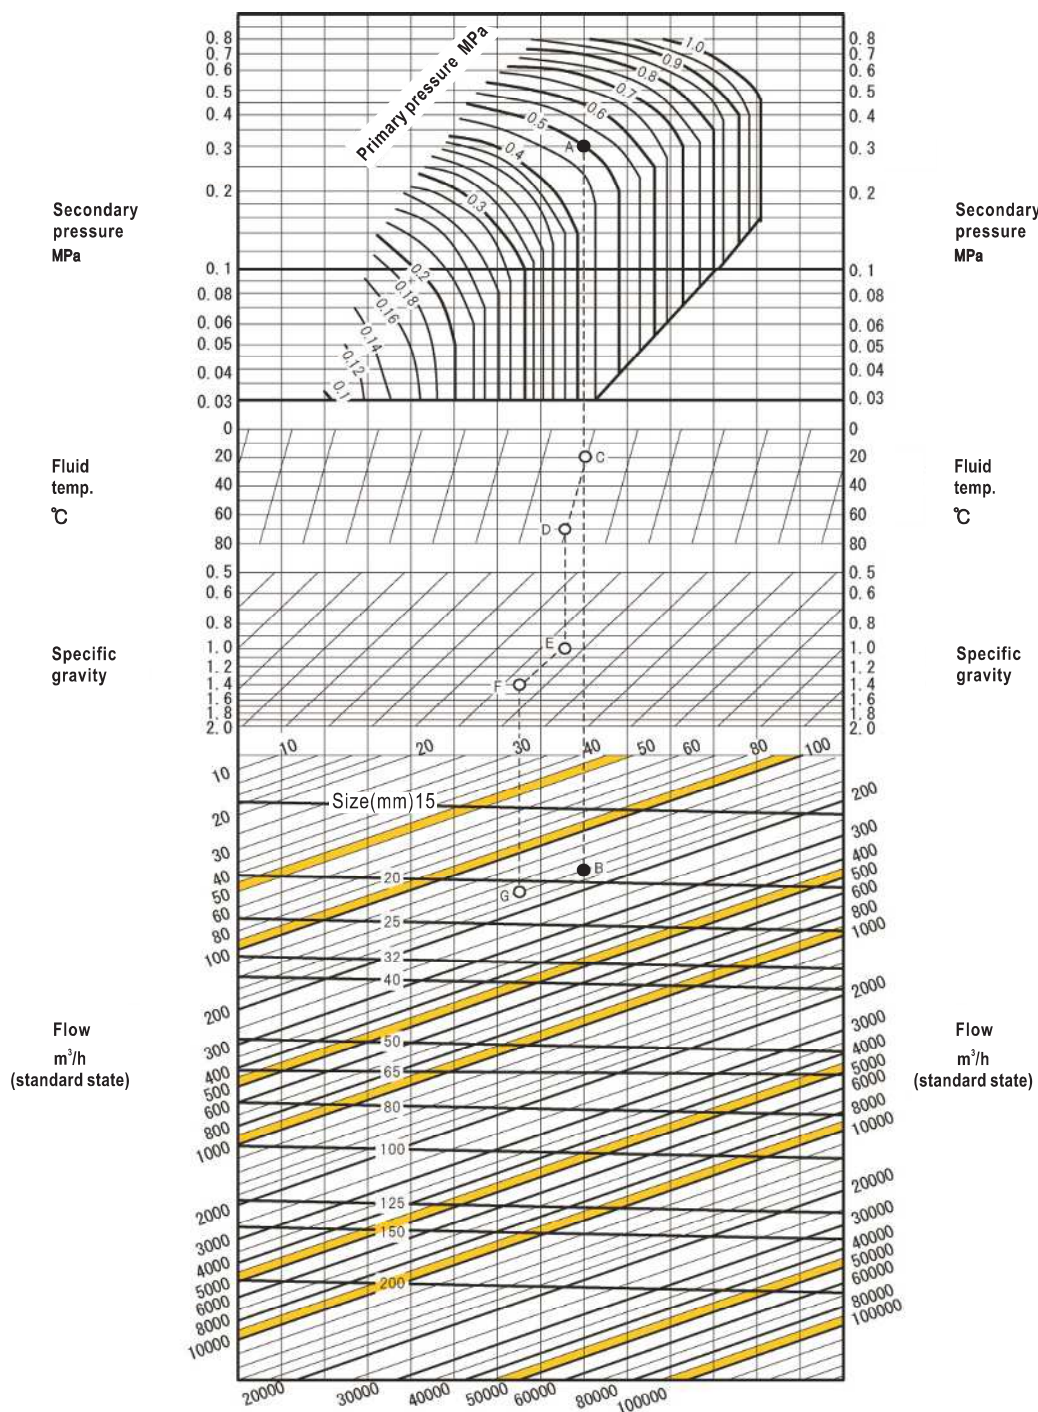

● HOW TO USE THE CHART

This example shows you how to decide nominal diameter of valve at the following conditions: primary pressure 0.5 MPa; secondary pressure 0.3 MPa; temperature 20°C; specific gravity 1 (air); and flow 160m³/h (standard state).

First, find out the intersection point A of primary pressure curve 0.5MPa and secondary pressure curve 0.3MPa.

Draw a vertical line from point A. This line intersects with flow curve 160m³/h. The intersection point is B. Since B is located between a nominal

diameter range of size 15~20mm. The larger value, which is size 20mm, is taken as the nominal diameter that we are looking for.


Now let's find out the nominal diameter when some conditions are changed. The other conditions are the same, but the temperature is 70°C, and the specific gravity is 1.4. Draw a vertical from point A until it intersects with the temperature curve 20°C. The intersection point is named C. Now move from point C to temperature curve 70°C parallelly and we can stop at point D. Draw a

vertical line from point D until it intersects with specific gravity curve 1.4. The intersection point is named E.

Now move from point E parallelly to point F. Draw a vertical line from point F until it intersects with flow curve (160m³/h). The intersection point is named G. Since point G is located between a nominal diameter range of 20~25mm. The larger value, which is 25mm, is taken as the nominal diameter that we are looking for.


DATA/RP-Type Pressure Reducing Valve (RP-6,8,9,10,11 Type Series) (for Steam or Gases)

■ FLOW CHARACTERISTICS

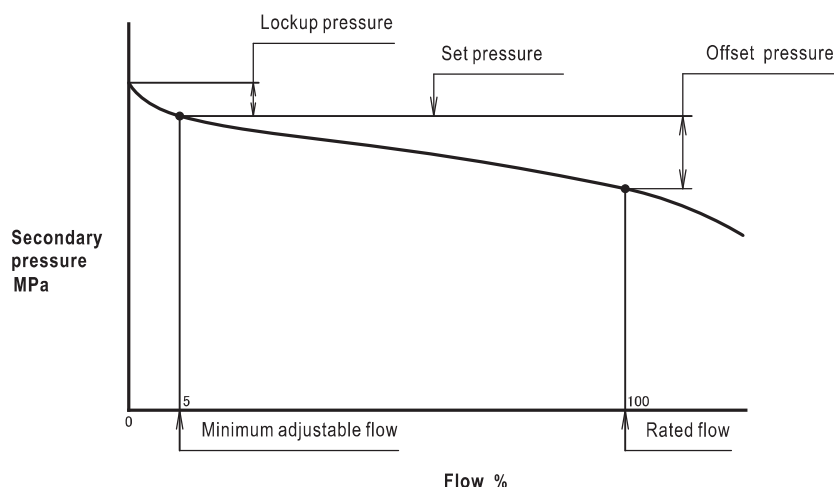

■ PRESSURE CHARACTERISTICS

Example: RP-6 Type

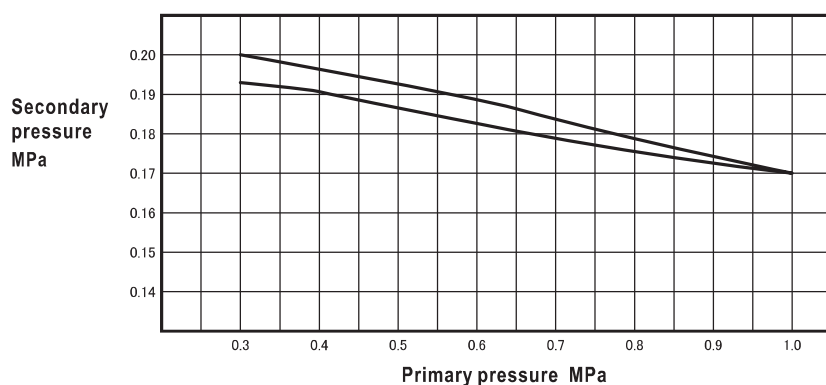

The secondary pressure is set at 0.2 MPa when primary pressure is 0.3 MPa. The chart shows the change of secondary pressure when primary pressure changes between 0.3~1.0~0.3 MPa.

■ TERMS

- **Primary pressure:** The inlet pressure of pressure reducing valve or the inlet pressure of piping that is near to pressure reducing valve.
- **Secondary pressure:** The outlet pressure of pressure reducing valve or the outlet pressure of piping that is near to pressure reducing valve.
- **Set pressure:** Secondary pressure at minimum adjustable flow.
- **Offset pressure:** The difference between secondary pressure and set pressure when primary pressure is kept at a constant level but flow increases gradually from minimal adjustable flow to the rated flow of pressure reducing valve.
- **Lockup pressure:** The increased pressure above set pressure when the secondary valve of pressure reducing valve is closed.
- **Minimum adjustable flow:** The minimum flow of pressure reducing valve for maintaining stable flow.
- **Rated flow:** The maximum flow at the specified offset pressure when primary pressure is kept at a constant level.

■ TIPS:HOW TO SELECT AN APPROPRIATE NOMINAL DIAMETER?

- ① When you select the size, use nominal diameter selection chart. Considering pressure loss and thermal loss, the flow amount for selecting the nominal diameter should be larger by 10-20% than designed flow amount, particularly in case of the pressure reducing rate is large or the set pressure is lower than 0.1MPa.
- ② The secondary pressure of a pressure reducing valve changes when primary pressure or flow changes. Therefore, when selecting nominal diameter, it is necessary to consider lockup pressure and offset.
- ③ In the case when primary and secondary pressure are not constant but change within a certain range, the nominal diameter can be determined using the primary and secondary pressures that produce the smallest differential pressure.
- ④ In the case the pressure reduction rate exceeds its maximum value, it is required to perform two-step pressure reduction by using 2 pressure reducing valves. Although the flow at step 1 and step 2 are the same, the nominal diameter of the valve at step 1 should be different from that at step 2, because primary pressure is different from secondary pressure. Therefore, it is necessary to select two nominal diameters for the valves to be used.
- ⑤ It is easy to understand that an extremely small valve allows only a tiny flow. However, this does not mean a large valve is better than a small valve. In fact, an extremely large valve may cause the occurrence of "hunting", which can lead to abnormal wearing. Another thing to be noted is the minimum adjustable flow, which is about 5% of the rated flow. You should not select a valve which may be used when the flow is lower than the minimum adjustable flow. In winter or summer, flow may change extremely. It is recommended that you install two pressure reducing valves, a large one and a smaller one, and switch between them according to change of flow.

(See flow characteristics and pressure characteristics.)

■ INSTALLATION EXAMPLE

Fig.1 With bypass piping


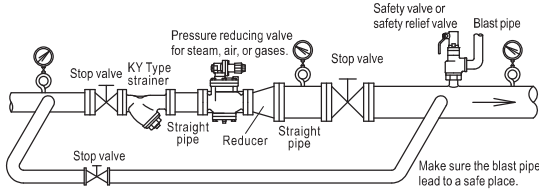


Fig.2 Without bypass piping

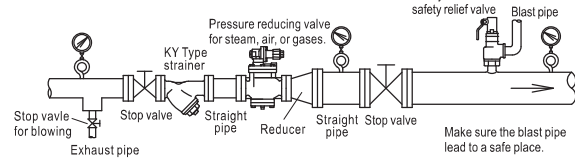

■ POINTS FOR INSTALLATION

- Installation of pressure reducing valve and piping.
- 1. Pressure reducing valve should be installed in horizontal pipe vertically.
- 2. Install safety valve or safety relief valve on the secondary side of pressure reducing valve.
 - ※ 1. Equipment may be damaged due to increase of secondary pressure at the time of failure of pressure reducing valve.
 - ※ 2. See Table 1 for set pressure of safety valve and safety relief valve.
 - ※ 3. In the case safety valve or safety relief valve is used as an alarm, its nominal diameter should be big enough to allow discharge of 10% maximum flow of pressure reducing valve, which is about the leakage of pressure reducing valve. In very few cases, safety valve or safety relief valve may allow discharge of maximum flow of pressure reducing valve. (reference value: see Table 2 and Table 3).

TABLE2. FLOW FOR SAFETY RELIEF VALVE (Saturated steam)

SL-37~40 TYPE (kg/h)

Set pressure (MPa)	Size(mm)					
	15(1/2")	20(3/4")	25(1")	32(1 1/4")	40(1 1/2")	50(2")
0.05	13.5	23.1	33.5	62.2	97.4	158
0.1	17.5	29.8	43.4	80.4	125	204
0.2	25.4	43.3	63	116	182	297
0.3	34.2	58.2	84.6	156	245	399
0.4	42	71.6	104	193	302	490
0.5	50.6	86.2	125	232	363	590
0.6	59.2	100	146	271	424	690
0.7	67.7	115	167	310	486	790
0.8	76.3	129	188	350	547	890
0.9	84	143	207	385	602	979
1.0	92.4	157	228	424	663	1070

TABLE1. SET PRESSURE FOR SAFETY RELIEF VALVE

(MPa)

Set pressure of pressure reducing valve	Set pressure of safety valve [※]
0.1 or less	+ 0.05 (+0.08)
Over 0.1 and less than 0.4	+ 0.08 (+0.14)
0.4 or more and less than 0.6	+ 0.12 (+0.2)
0.6 or more and less than 0.8	+ 0.15 (+0.28)
0.8 or more and less than 1.0	+ 0.19
1.0 or more and 1.2 or less	+ 0.23

Add the above value to set pressure of the pressure reducing valve.

※ 1. The above value is added to the set pressure of pressure-reducing valve.

※ 2. The values in parentheses are applicable to soft-seated type (SL-37V~40FV, 43V, 44V Type).

TABLE3. FLOW FOR SAFETY RELIEF VALVE (Air)

SL-37~40 TYPE (kg/h)

Set pressure (MPa)	Size(mm)					
	15(1/2")	20(3/4")	25(1")	32(1 1/4")	40(1 1/2")	50(2")
0.05	21.7	37	53.8	99.8	156	253
0.1	28.3	48.3	70.2	130	203	331
0.2	41.2	70.2	102	189	296	481
0.3	55.3	94.3	137	254	397	645
0.4	69.5	118	171	318	498	810
0.5	83.6	142	206	383	600	975
0.6	97.7	166	241	448	701	1140
0.7	111	190	276	513	803	1300
0.8	126	214	311	578	904	1470
0.9	140	238	346	643	1000	1630
1.0	154	262	381	708	1100	1790

- 3. Install strainer at the primary side of pressure reducing valve.
- 4. For devices that cannot be stopped, install bypass piping (with stop valve) from the primary side to the secondary side of pressure reducing valve. If bypass piping is not suitable, then install blowing stop valve, which is derived from the main pipe before the primary side of pressure reducing valve, so as to make flushing possible.
- 5. Install straight piping, stop valve, and pressure gauge before and after pressure reducing valve.
 - If end connection of pressure reducing valve is realized using screw, then use union joint to make it easy to fix and remove.
 - ※ The diameter of piping before and after pressure reducing valve should be determined based on the standard velocity of flow of fluid. Generally, since the nominal diameter of secondary piping of pressure reducing valve for steam and gases is larger than the diameter of pressure reducing valve, it is necessary to use reducer.
- 6. If you install solenoid valve (on/off operation) or control valve at the secondary side of pressure reducing valve, there should be an interval (L) between such solenoid valve or control valve and pressure reducing valve. The interval (L) should be larger than 2m in the case of solenoid valve. As for control valve, the interval should be larger than 1m if nominal diameter is less than 100mm, and larger than 1.5m if nominal diameter is larger than 125mm (see Fig.3).
- 7. In the case of 2-step pressure reduction, the interval between 2 valves should be 1~2m (see Fig.4).

Fig.3 INTERVAL BETWEEN PRESSURE REDUCING VALVE AND CONTROL VALVE


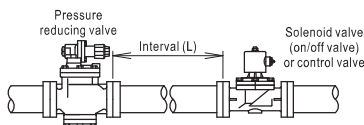


Fig.4 INTERVAL BETWEEN VALVES (2-STEP PRESSURE REDUCTION)

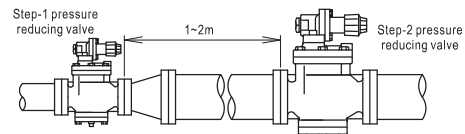

DATA/Pressure Reducing Valve (for Steam or Gases)

8. For pressure reducing valve for steam, "hunting" or vibration may occur if drain accumulates.

To prevent hunting and vibration, it is necessary to prevent drain from entering into the piping or install steam trap at the primary side.

In addition, since pressure reducing valve cannot be closed completely, it is necessary to install steam trap at the secondary side if the amount of steam used is near zero. (See Fig.7)

Fig.5: Proper installation

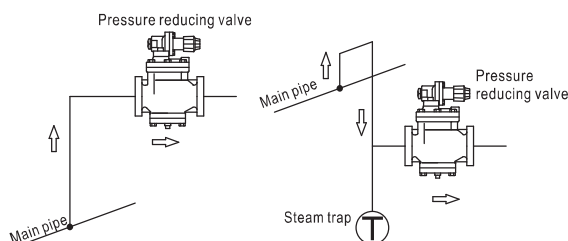


Fig.6: Improper installation


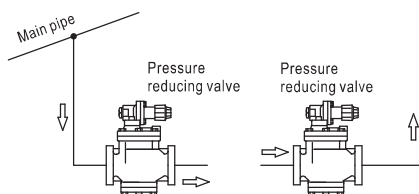


Fig.7: In case of zero steam consumption at secondary side of pressure reducing valve

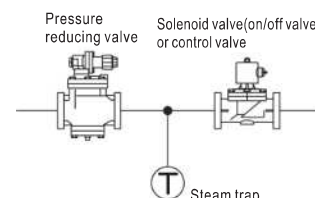

9. Make sure sufficient space should be left for maintenance.

10. Apply appropriate support to pressure reducing valve to make sure it should not bear the weight of piping, bending force, or vibration directly.

11. If there is possibility of freezing, apply thermal insulation or discharge the drain.

12. The secondary pressure of the valve is not adjusted at delivery. Therefore, you should adjust the secondary pressure to the desired pressure before use.


※ The secondary pressure of a non-adjusted valve is near to zero.

※ How to adjust the secondary pressure:


- ① Close the stop valves at primary and secondary sides.
- ② Open the blowing stop valve or stop valve in bypass and remove any content inside. Such operation is called flushing and should be carried out sufficiently by spending sufficient time on it. Take care not to make the secondary pressure rise excessively.
- ③ Close the stop valve in by pass or blowing stop valve completely.
- ④ Make sure there is not any spring load caused by adjusting screw.
- ⑤ Open the stop valve at primary side gradually.
- ⑥ Make sure you have adjusted the secondary pressure. Open the stop valve at the secondary side slightly to allow small flow.
- ⑦ Apply a small spring load using handle or adjusting screw. Once the fluid starts flowing, open the stop valve at the secondary side gradually.
- ⑧ Read the pressure gauge and apply more spring load to make the pressure reach the set pressure. The pressure rises if you turn the handle or adjusting screw in the right direction and falls if you turn them in the left direction.
- ⑨ Once the desired pressure is reached, use the lock nut to lock the adjusting screw. After the screw is locked, the spring load will not change.

• ADJUSTING SECONDARY PRESSURE

For RP-6 Type series and RD-40 Type series.

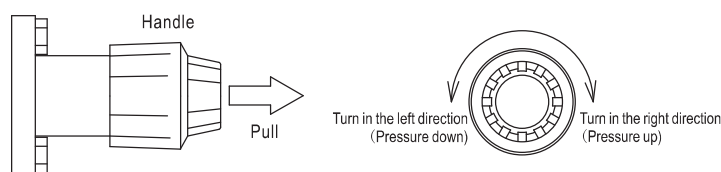

• OTHER PRESSURE REDUCING VALVES

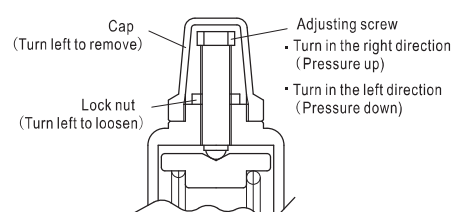

■ DIAMETER OF PIPING BEFORE AND AFTER PRESSURE REDUCING VALVE

The nominal diameter of pressure reducing valve can be determined using relevant graphs made for such purpose. The diameter of piping before and after pressure reducing valve must be determined based on the standard velocity of fluid.

Extremely small diameter or large velocity of fluid may cause large loss of pressure inside the piping and wearing, vibration of the piping. Therefore, it is necessary to consider the standard velocity of fluid when determining the diameter of piping.

● Table of velocity of steam as standard condition.

Item	For steam	Standard velocity (m/s)
Pipeage	Saturated steam (0.2~0.5MPa)	15~20
	Saturated steam (0.5~1.5MPa)	20~30
(Steam engine)	Saturated steam	20~30
	Super heated steam	30~40

● Table of velocity of air as standard condition.

Item	For air	Standard velocity(m/s)
Pipeage	(0.1~0.2MPa)	8~15
	(20~30MPa)	5~7
(Compressor)	Saturated line	10~20
	Low pressure supplyline	20~30
	High pressure supply line	10~15