

AT-1A, 1S Type Radiator Trap

Bellows type Max. 100kPa
Trap for heater radiator

Bellows type radiator trap for Max. 100 kPa heater radiator can also be used as the pipe end trap for low pressure pipeline.




AT-1A Type




AT-1S Type

CONSTRUCTION

AT-1A Type

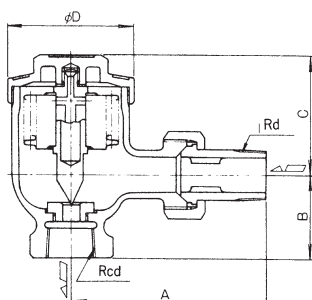

AT-1S Type

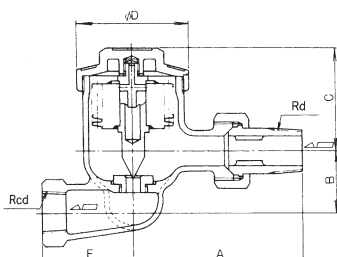

FEATURES

- Protects from freezing by the construction for no accumulation of drain.
- Rapidly discharge drain and air that occur when beginning of operation.

SPECIFICATIONS

Model name	AT-1A	AT-1S
Code name	AT1A-F	AT1S-F
Shape	Angle Type	Straight Type
Applicable fluid	Steam	
Fluid temperature	Max. 120°C	
Applicable pressure	Max. 100kPa	
End connection	Inlet:Screwed JIS R(Union joint), Outlet:Screwed JIS Rc	
Materials	Body(Cast bronze chrome plated), Disc & seat(Brass), Bellows(Phosphor bronze)	
Valve body pressure test	Hydraulic 200kPa(Bellows:Hydraulic 120kPa)	

DIMENSIONS AT-1A Type (Angle type)

(mm)

Size	d	A	B	C	D	Mass(kg)
15(1/2")	1/2"	80	35	46	52	0.55
20(3/4")	3/4"	87	41	52.5	57	0.72
25(1")	1"	105	52	61.5	57	1.32

DIMENSIONS AT-1S Type (Straight type)

(mm)

Size	d	A	B	C	D	E	Mass(kg)
15(1/2")	1/2"	80	28	48	52	43	0.66
20(3/4")	3/4"	87	34	52.5	57	48	0.94
25(1")	1"	105	40	64.5	57	60	1.56

FLOW CHART

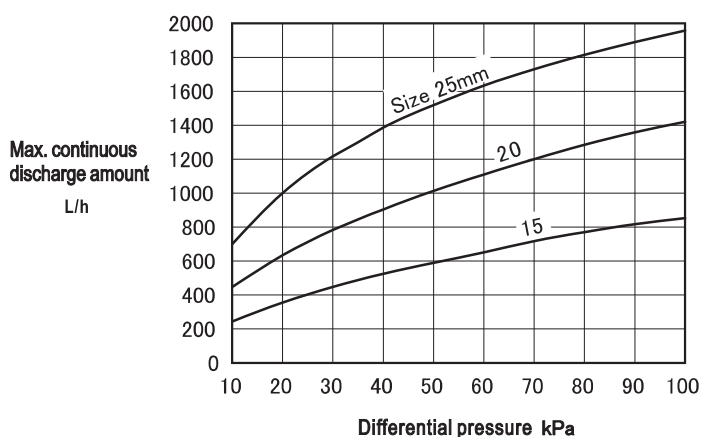


TABLE FOR CAPACITY (Max. continual discharge amount)

(L/h)

Size	Differential pressure (kPa)	10	35	50	70	100
15(1/2")		240	470	570	690	840
20(3/4")		430	830	1000	1190	1390
25(1")		700	1300	1500	1740	1930

POINTS FOR SIZE SELECTION

Select a proper size that can meet the requirement on safety factor and allow at least 3 times of planned discharge amount.

In the case there is back pressure at the outlet side of trap, use the differential pressure between inlet and outlet sides to select the size of valve.


CAUTIONS ON INSTALLATION

- Confirm the direction of flow before installation.
- If union nipple is used, take care not to damage the sealing surface between the product and the main body.
- Drain may accumulate in the valve if the outlet side piping is an ascending type. To prevent freezing in such case, install drain hole.

DATA/Steam Trap


EXAMPLE: APPLICATION OF STEAM TRAP

STEAM SUPPLY PIPELINE (main pipe · branch pipe · header, etc.)

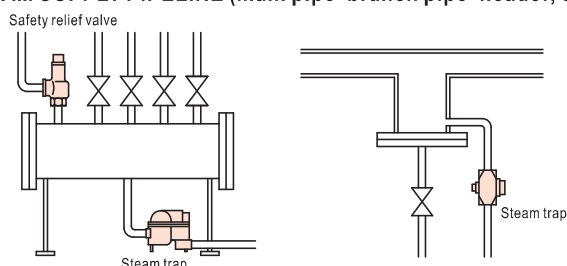


- **Points for selection:**
There is a large difference between the amount of drain generated at normal operation state and that generated at start up. Large amount of air and drain generated at start up may obstruct the supply of steam.
- **Applicable model:**
ATB-5, 5F/AT-6, 6F Type (thermo element type)
AD Type series (disc type)
AK Type series (bucket type), AF Type series (float type)

CLEANING EQUIPMENTS (press machine · drying machine, etc.)

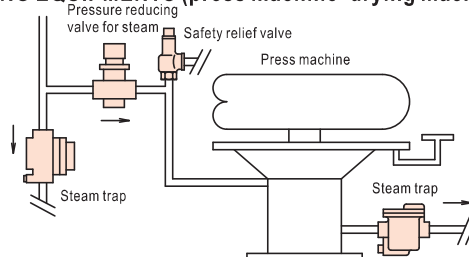


- **Points for selection:**
Pay attention to selection of the size of steam trap, because the load changes drastically.
- **Applicable model:**
AD Type series (disc type)
AK Type series (bucket type)
AF Type series (float type)

AIR CONDITIONING · MANUFACTURING EQUIPMENTS (heat exchanger, etc.)

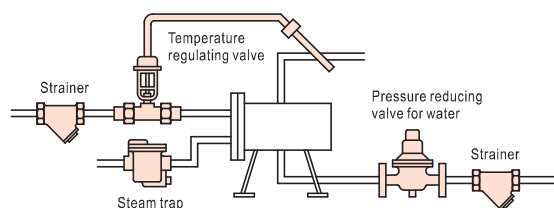


- **Points for selection:**
Large amount of drain is generated for maximal utilization of the heat of steam. There is a large difference between the amount of drain generated at normal operation state and that generated at start up.
- **Applicable model:**
AF Type series (float type)
AK Type series (bucket type)

(Air handling unit)

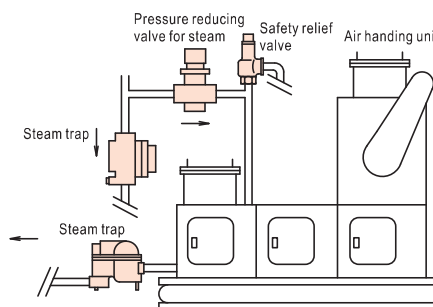


- **Points for selection:**
Large amount of drain is generated for maximal utilization of the heat of steam. In addition, the amount and temperature of air feed also affect the amount of drain generated.
- **Applicable model:**
AF Type series (float type)
AK Type series (bucket type)

FOOD PROCESSING EQUIPMENTS · KITCHEN UTENSILS (stew pot · heating pot, etc.)

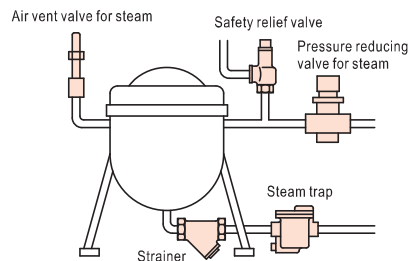

- **Points for selection:**
Large amount of drain is generated for maximal utilization of the heat of steam. With the passing by of heating time, the amount of drain reduces.
- **Applicable model:**
AF Type series (float type)
AK Type series (bucket type)


MEDICAL · PHARMACEUTICAL · FOOD PROCESSING EQUIPMENTS (autoclave · sterilizer, etc.)

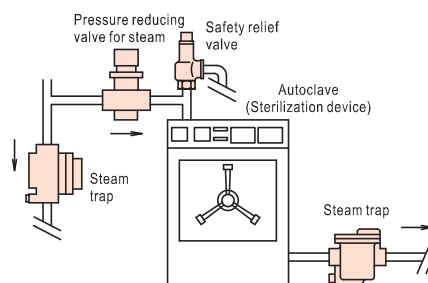

- **Points for selection:**
To rapidly increase the internal temperature, large amount of drain is generated during initial operation period. The amount of drain decreases after temperature becomes stable.
- **Applicable model:**
ATB-5, 5F/AT-6, 6F Type (thermo element type)
AD Type series (disc type)
AK Type series (bucket type)

PIPING EXAMPLE

Fig. 1 Piping example

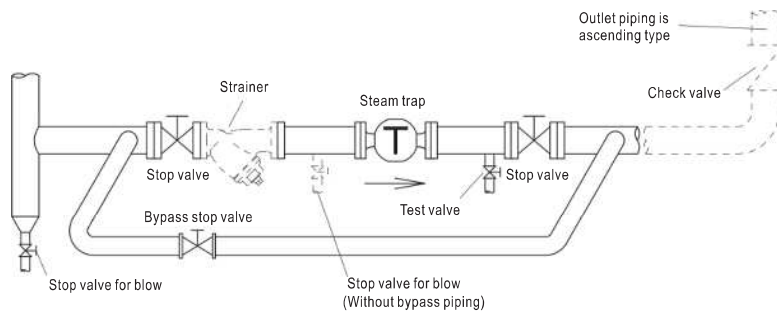

POINTS FOR SIZE SELECTION AND INSTALLATION

(Steam trap is hereinafter referred to as "trap".)

1. Select a proper size that can meet the requirement on safety factor and allow at least 3 times of planned discharge volume.
2. AT and ATB Type can detect drain temperature and open/close valve based on the temperature detected. When selecting size, pay attention to following issues:
 - ※1. Before the temperature of saturated steam drops to the temperature for valve opening, drain accumulates at the primary side of trap. Do not install trap on machines or equipments whose functions may be affected by accumulation of drain.
 - ※2. Avoid installing trap on machines or equipments using solenoid valve control for frequent feeding or stop feeding of steam. Such action may cause pressure changes drastically and reduce the durability of bellows and thermo element. (Applicable models: AT-1A, 1S, AT-6, 6F, 6FB, ATB-5, 5F Type)
 - ※3. The pipe at the inlet side of trap should be naked pipe that is more than 1m in length. Do not apply thermal insulation on trap. (Applicable models: AT-6, 6F, 6FB, ATB-5, 5F Type) (see Fig.2)
3. Install strainer at the primary side of trap.
 - ※ It may not be necessary to install strainer in the case of steam trap with strainer embedded. However, for ensuring stable operation, it is recommended installing strainer.
4. For devices whose operation cannot be stopped, install a bypass pipe (with stop valve) between the primary and secondary sides of steam trap (see Fig.1). If you choose not to install bypass pipe, install stop valve for blowing, which is branched from the main pipe, right before the stop valve at the primary side of steam trap, to make flushing possible.
5. The position of steam trap should be as low as possible to allow drain flow by its weight.
6. In the event trap is installed at the midway of main pipe, install a separator with the same diameter as of the main pipe (see Fig.3).
7. To install trap at pipe end, install a dirt pocket (which diameter is the same as that of main pipe) at pipe end, and install trap at the pipe which is branched from dirt pocket(see Fig.4).
8. When the discharge side of trap is piped to drain tank or waterspout, make sure such pipe does not submerge into water. In addition, install check valve to prevent back flow (see Fig. 5, 6).
9. When the discharge side of trap is piped to drain collecting pipe or other system, make sure the discharge pipe enters into such drain collecting pipe or system from the upper side, and install check valve if there is back pressure (see Fig.5).
10. In the event the discharge side of trap opens to atmosphere, make sure such outlet piping does not cause any danger. In addition, install BH-1 Type silencer to reduce noise that occurs when drain is discharged (see Fig.7).
11. In general, one trap is necessary for one unit of machine (see Fig.8).
12. The arrow mark on steam trap should match with the direction of the flow of fluid. Except for some models, steam trap should be installed vertically to horizontal pipe.
13. Leave some space for disassembling and maintenance.
14. Fix or support steam trap properly to avoid damage of steam trap due to the weight of pipe, stress, bending force or vibration.
15. Discharge drain if there is risk of freezing.
16. The secondary piping of AD-17B, 17FB Type (for cold area) should not be ascending type.

Fig.2 AT、ATB Type piping Example

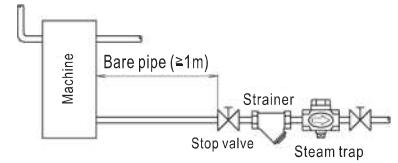


Fig.3 Installation at midway of pipe




Fig.4 Pipe end installation

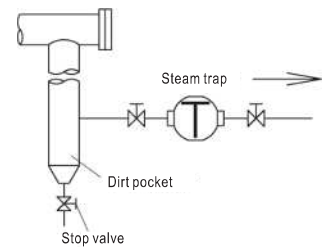


Fig.5 Drain tank piping

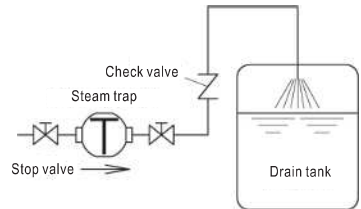


Fig.6 Waterspout Piping Example

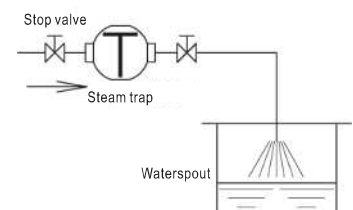


Fig.7 Discharge to atmosphere




Fig. 8 Installation on machine

